




赫兹电力
HERTZ POWER



HZBTC-II

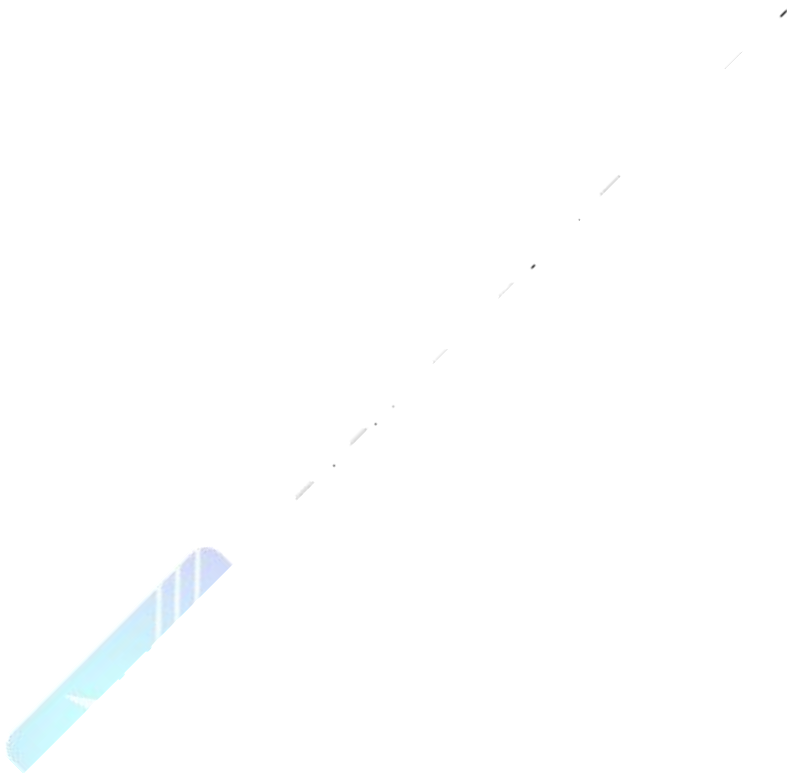



		4
		5
		6
		6
1		6
2		7
3		7
		8
1		8
2		10
3		13
4		14
5		16
6		18
6		19
7		20
8		20
9		21
10		21
		22
		22
1		22
2		22
		24
1		24
2		24
		25
		26
		26
		29
		30



1

2

3

4

S7 S9 S11 S13 S15 SCB9

SCB10 SCB11

5

6

7

8

9

750V

10

100A

PT

11

20kVA~100000kVA

5kVA~40000kVA

12

13


14

15

200



2

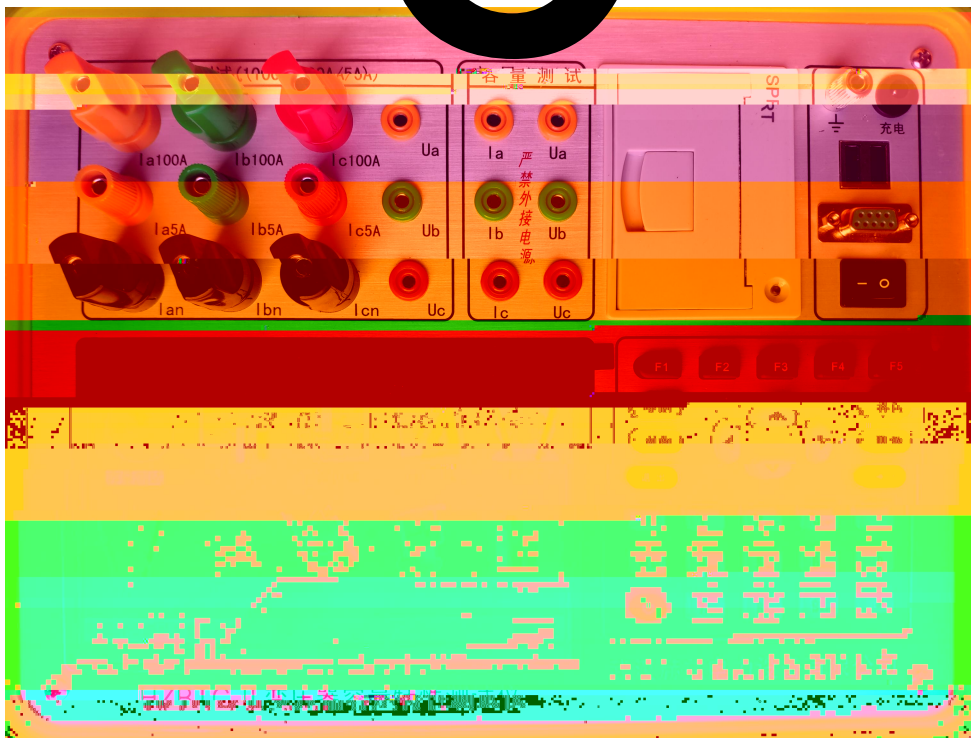

2

2
Ia100A A 5A Ia5A A
Ib100A B 5A Ib5A B
Ic100A C 5A Ic5A C
Ua Ub Uc RS232
A 100A
Ian B 100A
Ibn C 100A
Icn

3

30

F1-F5




0~9

Ã•EU% j




PT


CT



F1~F5



F4

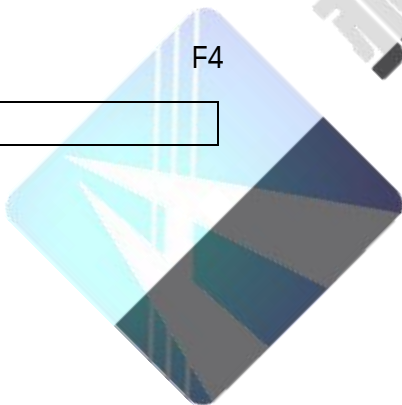

赫兹电力
HERTZ POWER





2

4

1

4



4





JB64 SJ 73 S7 S9 S11

S13



2



Yyn0 Dyn11 Yzn11



500 630

5



ABC

ABC

ABC

6



6

7



7

7

“ No type ”

“ no ”




“ ”

3

8



8

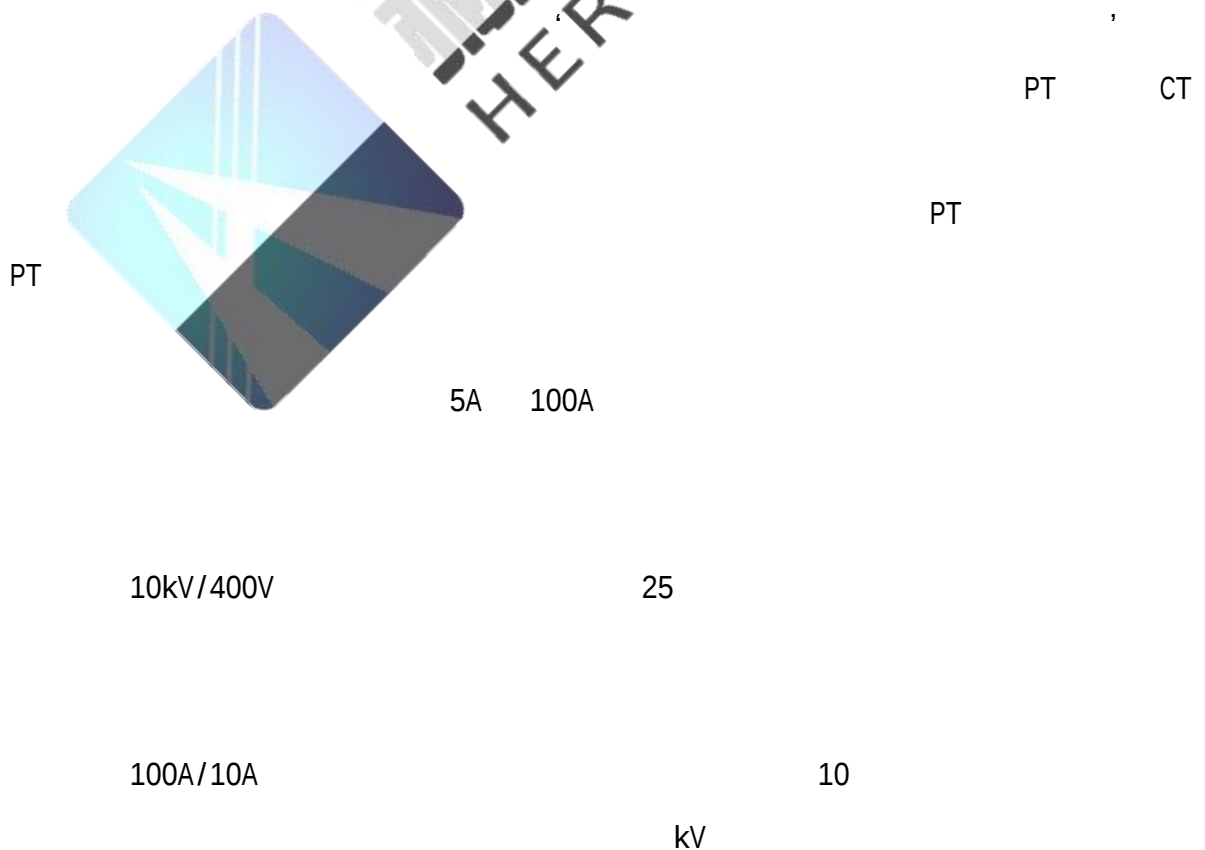

225


027-83267669



11



12

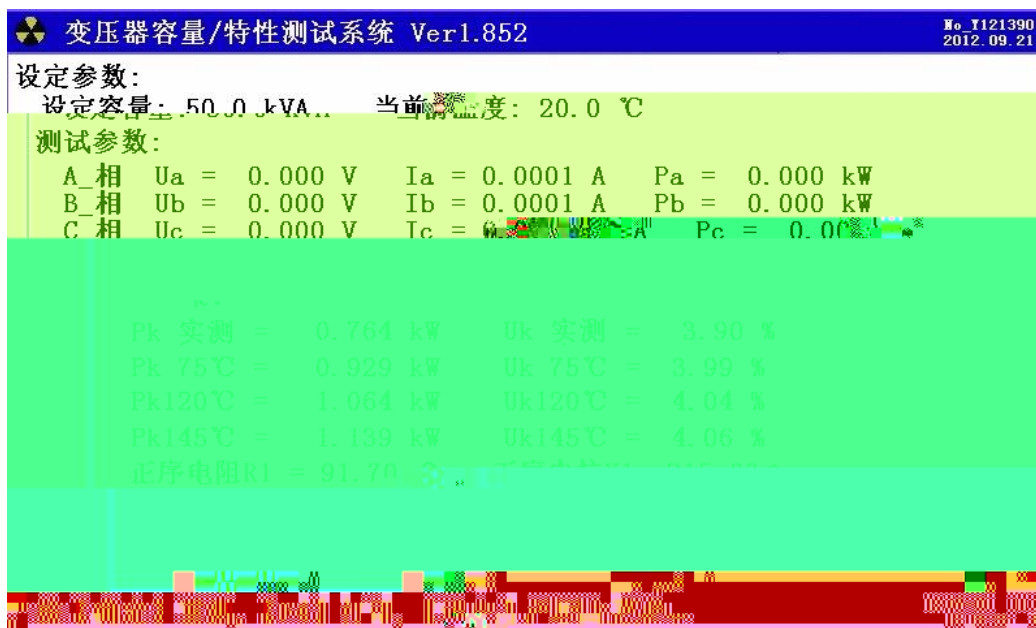

12

Ua

Ub Uc

Ia Ib Ic

Pa Pb Pc

Pk

Uk

75 100 120 145

Pk75 Pk100 Pk120 Pk145,

75 100 120 145


Uk75 Uk100

Uk120 Uk145

5

Y/Yn0

13 14 15 16

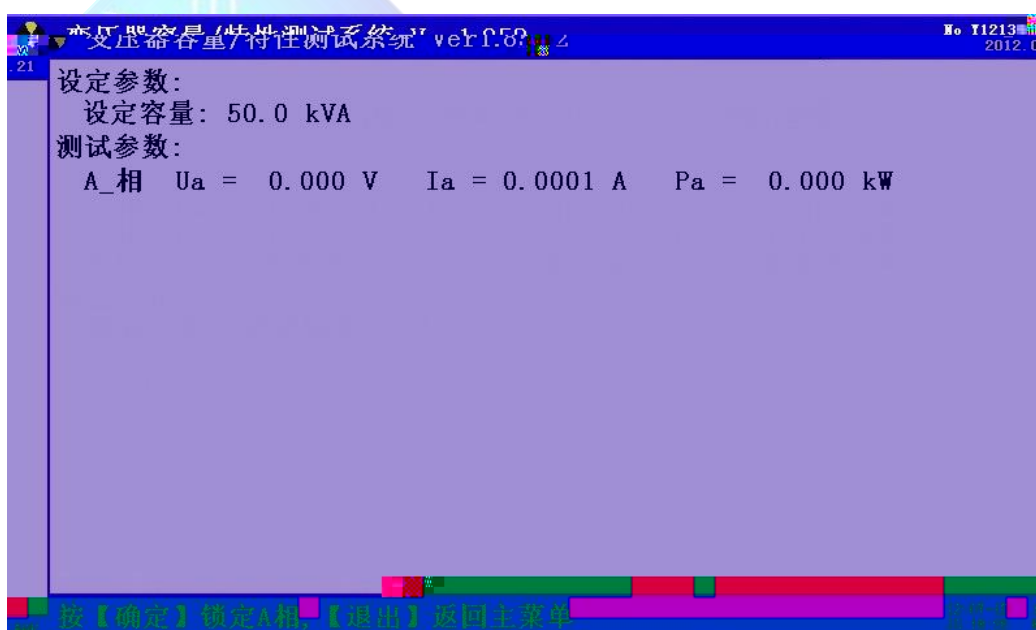

13

A



A

A

A

A

A

A

B

14

变压器容量/特性测试系统 Ver1.852 No. Y121390
2012.09.21

设定参数：
设定容量：50.0 kVA

测试参数：

A_相	Ua = 0.000 V	Ia = 0.000 A	Pa = 0.000 kW (锁定)
B_相	Ub = 0.000 V	Ib = 0.000 A	Pb = 0.000 kW (锁定)

确定】锁定B相，【退出】返回主菜单 12-07-10 11:59V 15.18.26 84.62%

14

B

B

B

B

B

B

B

C

变压器容量/特性测试系统 Ver1.852 No. Y121390
2012.09.21

设定参数：
设定容量：50.0 kVA

测试参数：

A_相	Ua = 0.000 V	Ia = 0.000 A	Pa = 0.000 kW (锁定)
B_相	Ub = 0.000 V	Ib = 0.000 A	Pb = 0.000 kW (锁定)
C_相	Uc = 0.000 V	Ic = 0.000 A	Pc = 0.000 kW (锁定)


按【确定】锁定C相，【退出】返回主菜单 12-07-10 11:59V 15.18.26 84.62%

15

C

C

C

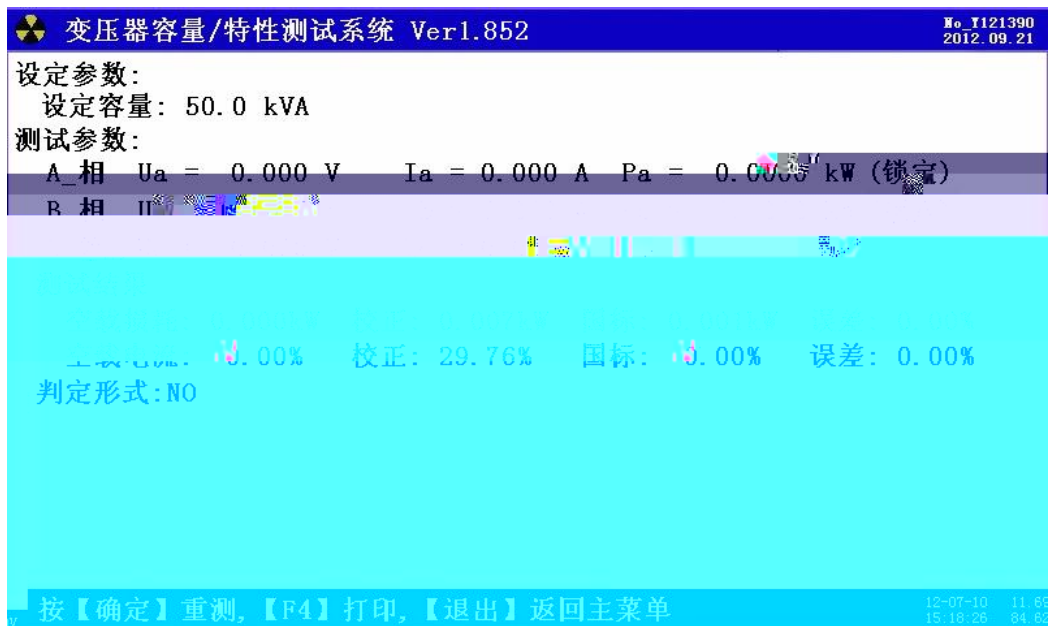

16

6

17 18



17

17

18



18

a

b

17

7

19





19

Ua

Ia


Pa

Uk

Pk

8

20

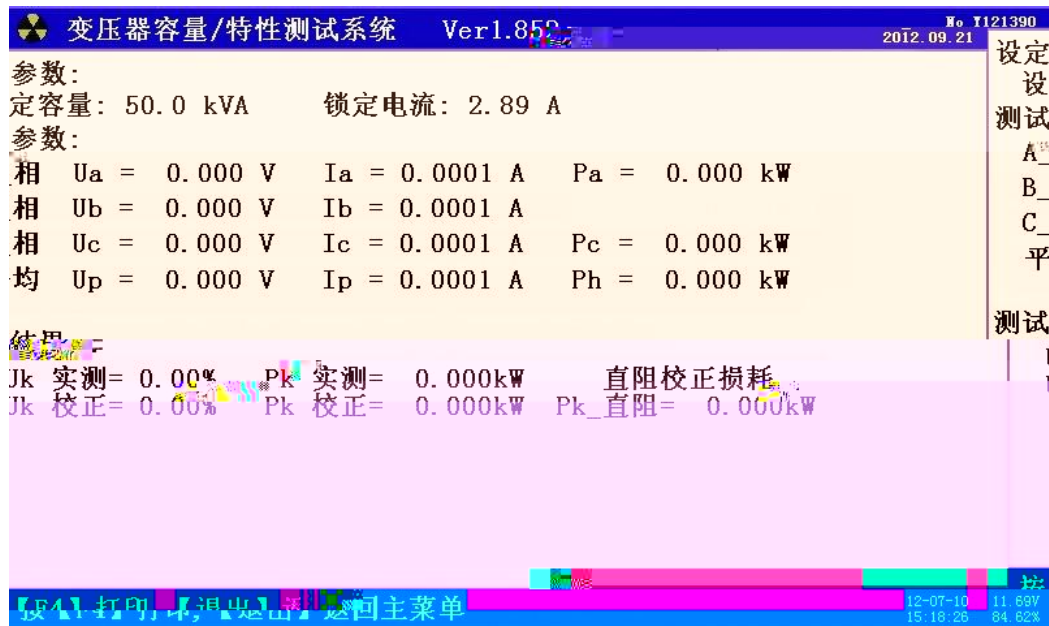

20

Uab Uac Ucb

Ia Ib Ic

Pa Pb Pc

Pk

Lock

Ip

Ph

Uk

75

100

120

145

Pk75

Pk100

Pk120

Pk145,

75

100

120

145

Uk75 Uk100 Uk120 Uk145

Up

Uk%

Pk


9

21




21

22

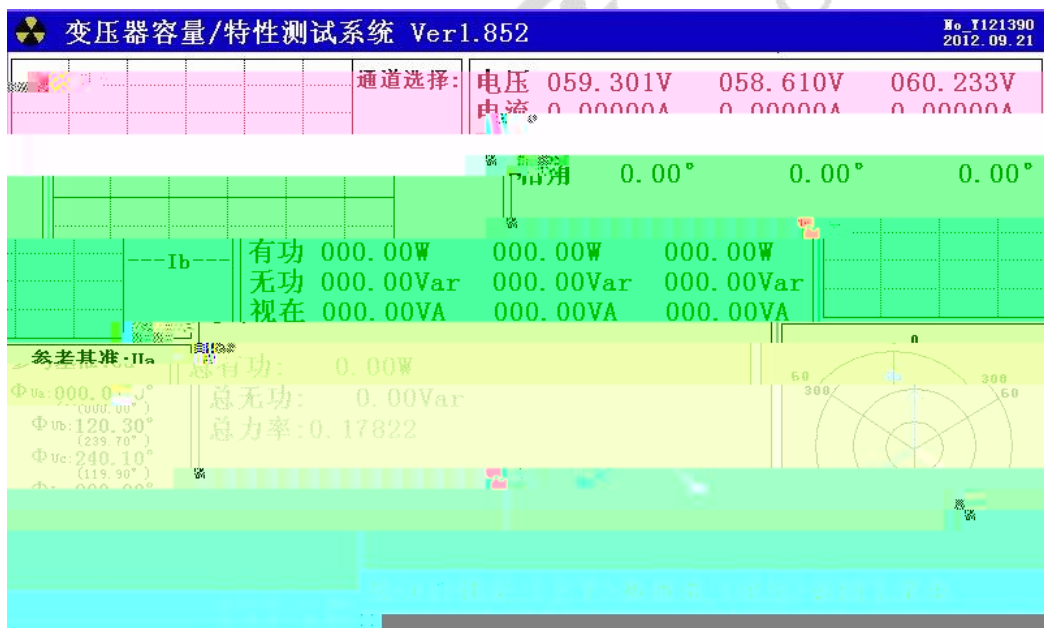

22

23

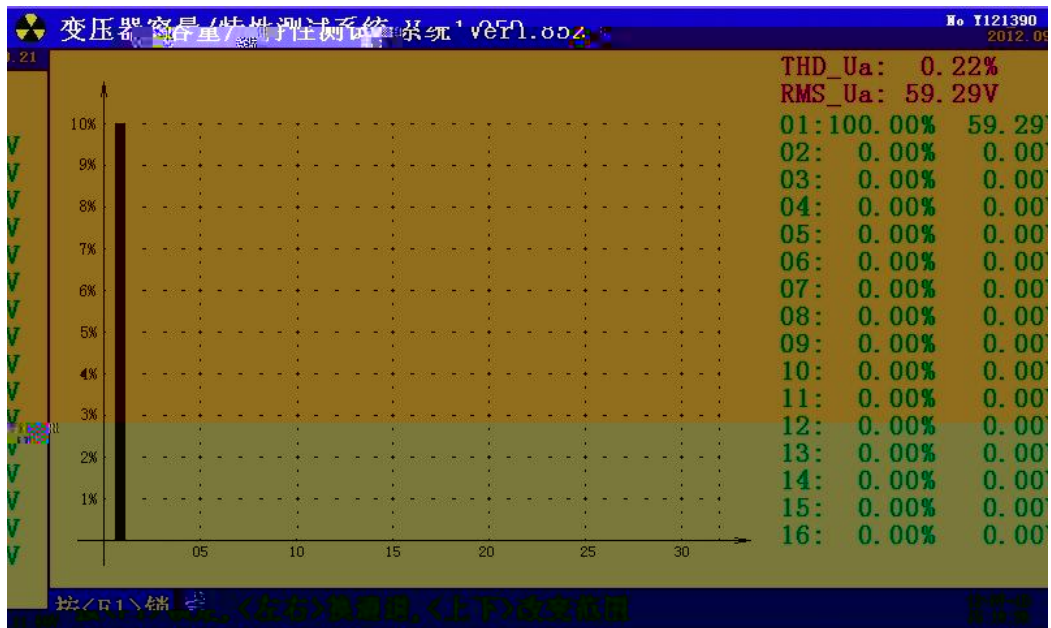

23

2 50

1


2




Ia Ib Ic

Ua Ub Uc

24

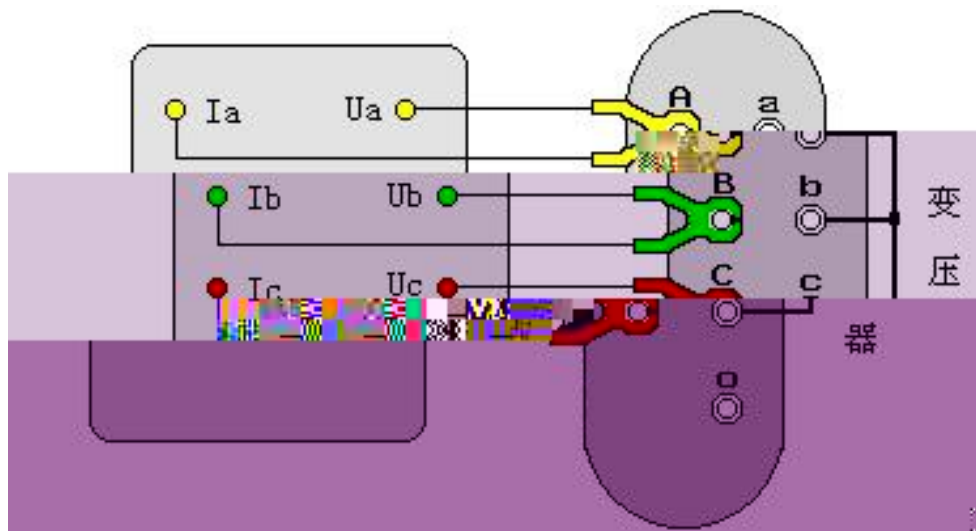

24

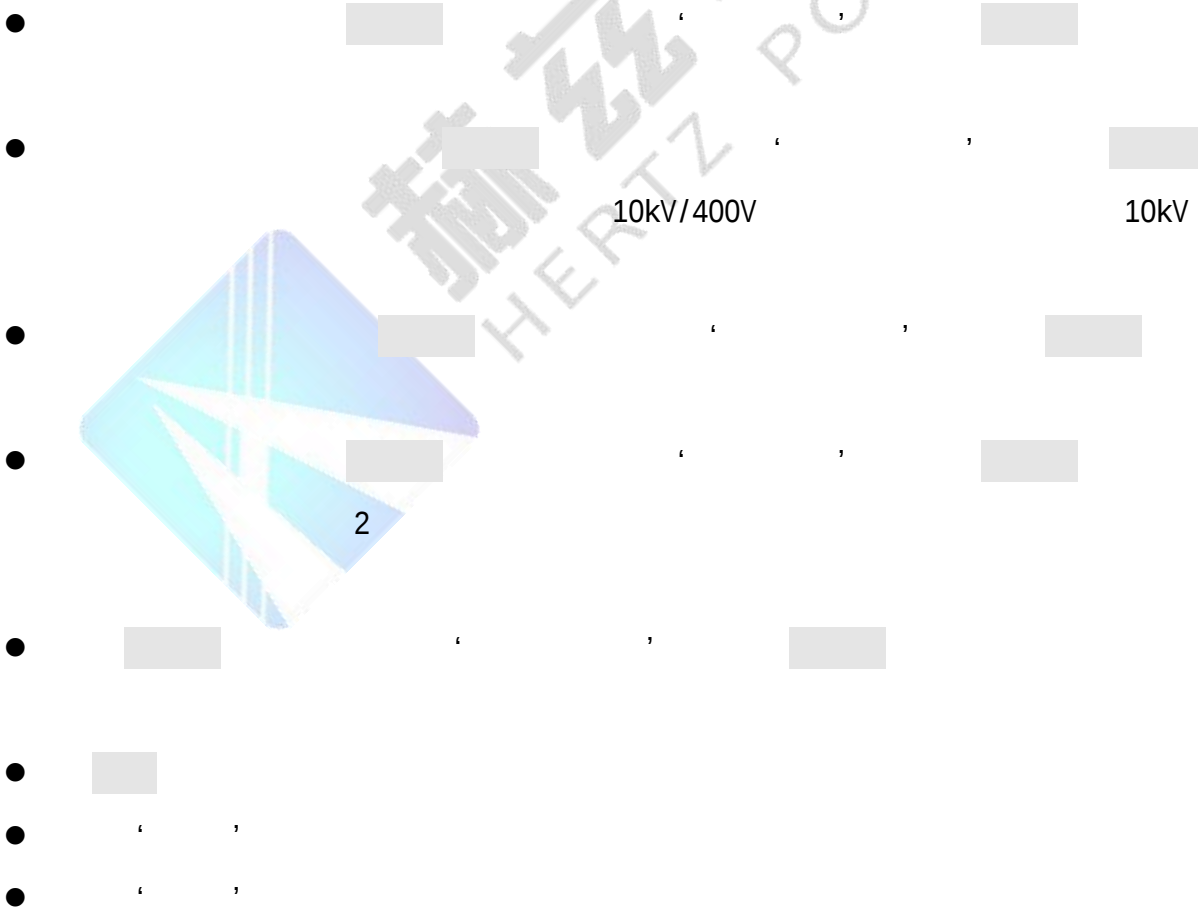



1

80%

2

Y/Yn0

220V


Ua Ub

A

Ao


Bo Co

25

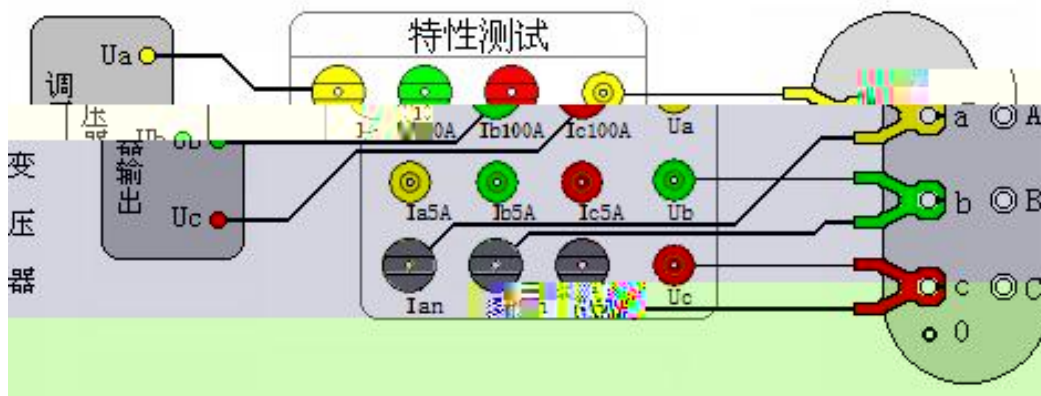


25

26

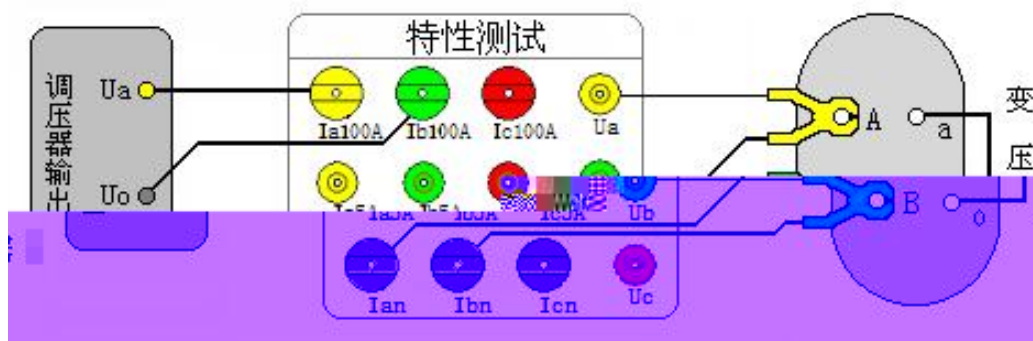

26

27

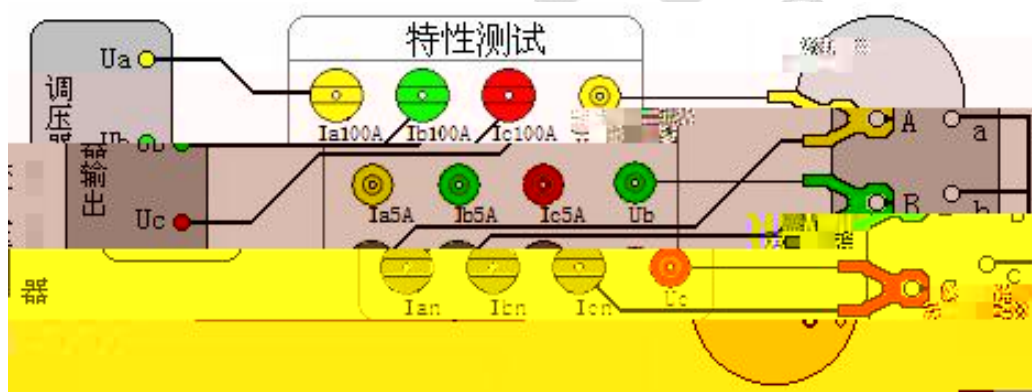

27

4



1

2

3

4

5

6

7

8

9

10

500kVA

630kVA

500

630





赫兹电力
HERTZ POWER

产品宗旨：技术领先 质量可靠 服务周到 信守合同

10kV(6kV)

(kVA)	A	A	kW			kW			%			%		
			S7	S9	S11	S7	S9	S11	S7	S9	S11	S7	S9	S11
				0.06			0.3			4.0			4	2.8
				0.1			0.5			4.0			3.5	2.4
30	1.732	43.3	0.15	0.13	0.1	0.8	0.6	0.6	4.0	4.0	4.0	2.8	2.3	1.8
50	2.887	72.17	0.19	0.17	0.13	1.15	0.87	0.87	4.0	4.0	4.0	2.6	2.0	1.6
63	3.637	90.94	0.22	0.2	0.15	1.4	1.04	1.04	4.0	4.0	4.0	2.5	1.9	1.5
80	4.619	115.5	0.27	0.25	0.18	1.65	1.25	1.25	4.0	4.0	4.0	2.4	1.9	1.5
100	5.774	144.3	0.32	0.29	0.2	2.0	1.5	1.5	4.0	4.0	4.0	2.3	1.8	1.4
125	7.217	180.4	0.37	0.34	0.24	2.45	1.8	1.8	4.0	4.0	4.0	2.2	1.7	1.4
160	9.238	230.9	0.46	0.4	0.28	2.85	2.2	2.2	4.0	4.0	4.0	2.1	1.6	1.3
200	11.55	288.7	0.54	0.48	0.33	3.5	2.6	2.6	4.0	4.0	4.0	2.1	1.5	1.2
250	14.43	360.9	0.64	0.56	0.4	4.0	3.05	3.05	4.0	4.0	4.0	2.0	1.4	1.1
315	18.19	454.7	0.76	0.67	0.48	4.8	3.65	3.65	4.0	4.0	4.0	2.0	1.4	1.1
400	23.09	577.4	0.92	0.8	0.57	5.8	4.3	4.3	4.0	4.0	4.0	1.9	1.3	1.0
500	28.87	721.7	1.08	0.96	0.68	6.9								

027-832676


ezhi@163.com



S9 35kV


(kVA)	kW	kW	%	%
50	0.21	1.25	6.5	2.0
100	0.3	2.03	6.5	1.8
125	0.34	2.35	6.5	1.75
160	0.38	2.82	6.5	1.65
200	0.44	3.30	6.5	1.55
250	0.51	3.90	6.5	1.40
315	0.61	4.70	6.5	1.40
400	0.74	5.70	6.5	1.30
500	0.87	6.90	6.5	1.30
630	1.04	8.20	6.5	1.25
800	1.25	10.0	6.5	1.05
1000	1.48	12.0	6.5	1.00
1250	1.76	14.0	6.5	0.85
1600	2.13	17.0	6.5	0.75

Y/Yn0

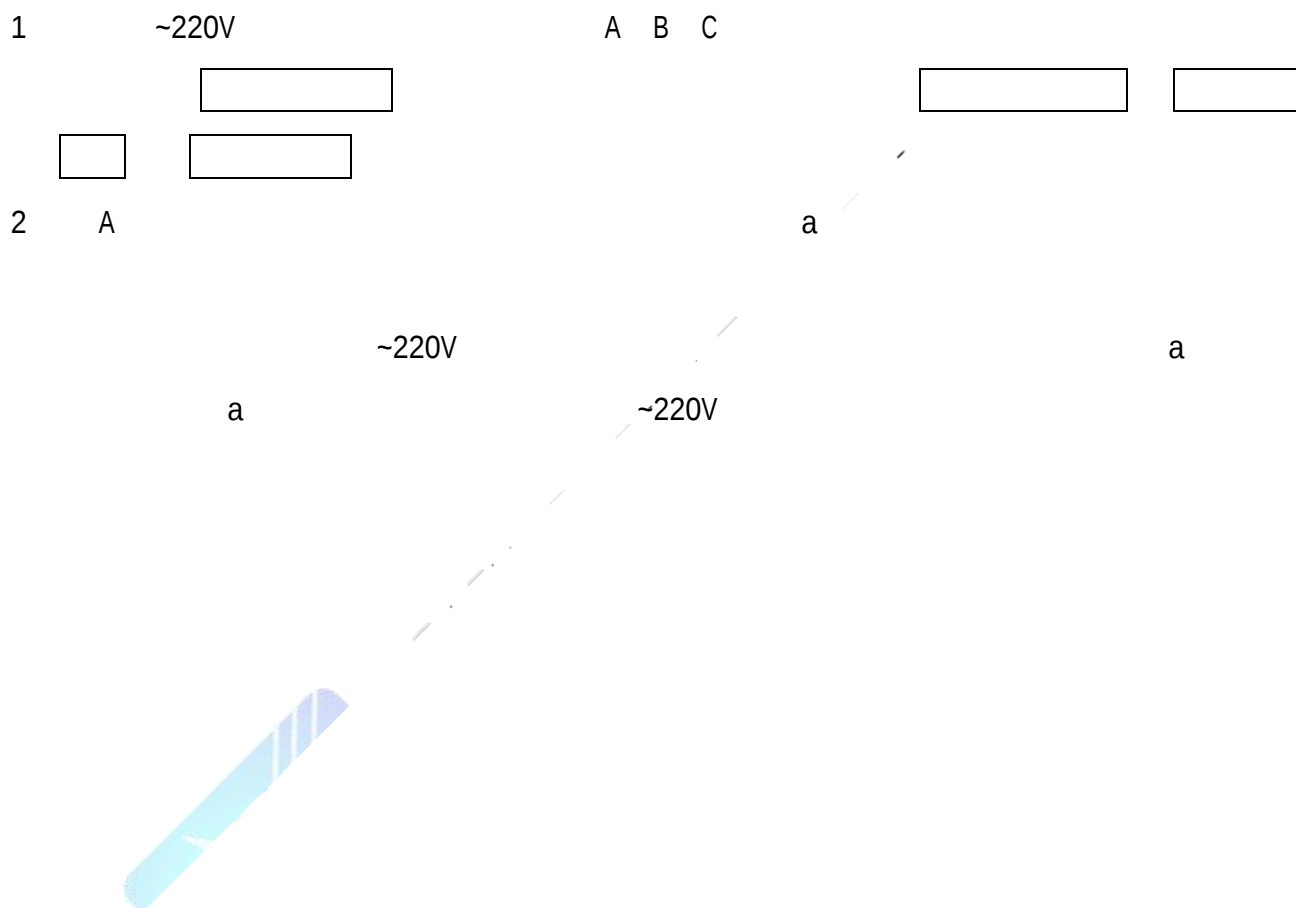



接线图

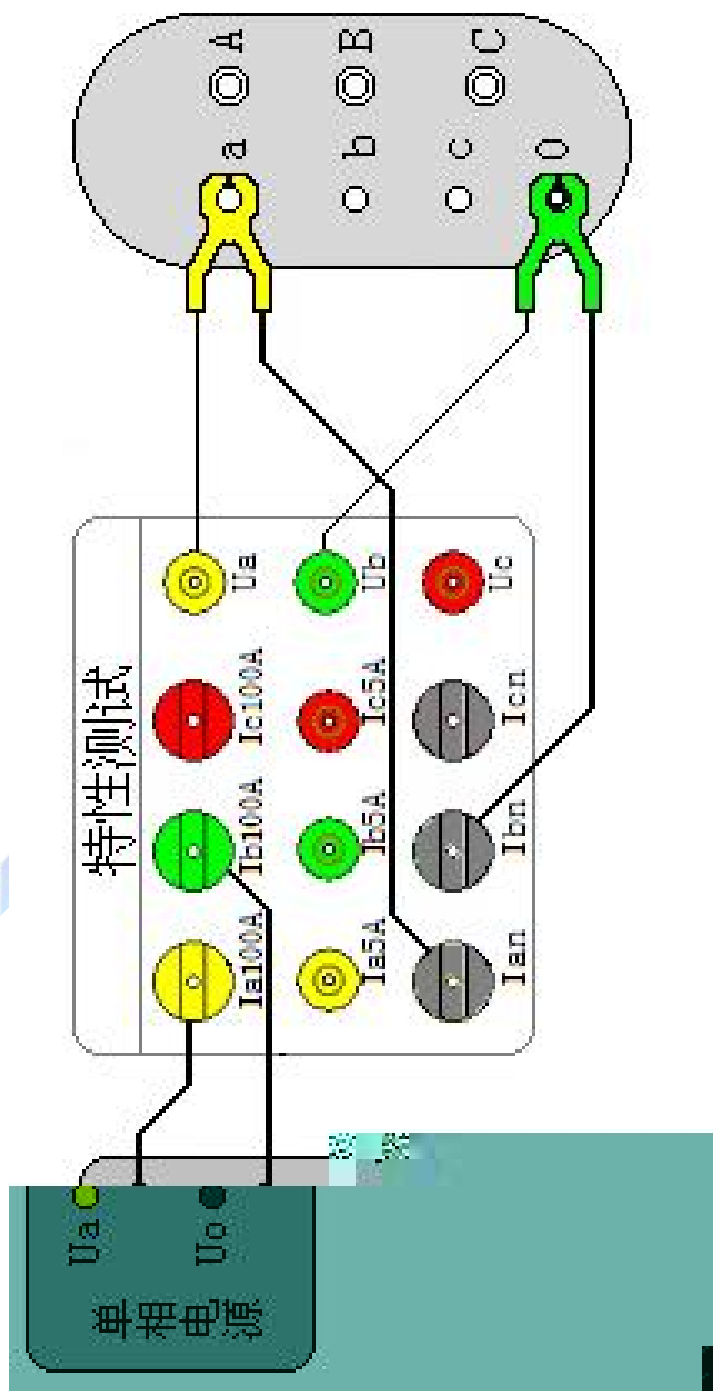



“ ”

“ ”

- 1.
- 2.
- 3.



“

”

“

”

“

”

